



7246

CDT Configuration and Diagnostics Tool

Profile Setup Manual

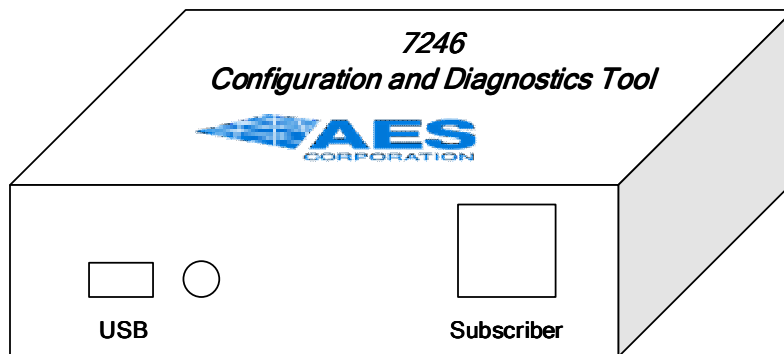


Table of Contents

1	SUMMARY	3
2	CLI CONNECTION	3
3	CONFIGURATION PROFILES.....	3
3.1	OVERVIEW	3
3.2	PROFILE SETUP	4
3.2.1	<i>Profile Management</i>	<i>4</i>
3.2.2	<i>Profile Editing</i>	<i>5</i>
3.2.3	<i>Default Profiles.....</i>	<i>6</i>
3.2.4	<i>Special TTL Profile.....</i>	<i>6</i>
3.2.5	<i>CLI Script</i>	<i>7</i>
3.2.6	<i>Profile Naming Conventions.....</i>	<i>8</i>
4	SUBSCRIBER CONFIGURATION	9
4.1	READ SUBSCRIBER CONFIGURATION	9
4.2	SAVE SUBSCRIBER CONFIGURATION.....	9
4.3	CONFIGURING THE SUBSCRIBER.....	9
5	DIAGNOSTICS	10
5.1	STATUS	10
5.2	ZONES.....	10
5.3	ROUTING.....	10
5.4	PACKETS	11
5.5	HISTORY	11
5.6	PSTATS.....	11
5.7	STORE.....	11
5.8	RECALL.....	11
5.9	DELETE.....	11
6	FIRMWARE UPDATE	12
7	REVISION HISTORY	13

1 Summary

The Configuration and Diagnostics Tool (CDT) is a module that enhances the functionality of the standard AES handheld programmer by implementing a number of interactive features used for configuration and diagnostics of an AES subscriber. This document describes the CLI interface used to create, edit, and store customized configuration profiles used for subscriber configuration.

2 CLI Connection

To access the CLI interface, first connect the USB port to a PC. Use Device Manager to determine which COM port is connected to the USB port. Open a terminal emulator on the COM port and configure it for 4800, n,8,1. Hit <ENTER> on the terminal to get the CDT-MAIN> prompt, then type "sct" to get to the CDT-SCT> prompt.

3 Configuration Profiles

3.1 Overview

The CDT can store a number of subscriber configurations called "profiles" that are used for configuring a subscriber in the field. This reduces the time and potential for error when configuring a subscriber by limiting the operator interface to a set of menu selections.

Before going to the field, the subscriber configuration profiles need to be setup and stored in the CDT using a CLI command interface. Communication with the CDT for the setup operation uses the USB port and a terminal emulator (ex: Hyperterm). Once the CDT profiles are setup, the unit is ready to be taken to the field to configure a subscriber.

In the field, the CDT is attached to the AES handheld programmer. The CDT is then connected via cable to the programming port of the subscriber. When the CDT is powered up, the operator is presented with menu selections for the desired mode (Configuration, Diagnostics, Programmer Mode). For subscriber configuration, enter F1. The configuration menu displays options (F1, F2, F3) for reading the subscriber, updating the subscriber configuration from the stored profiles, or storing the current subscriber configuration.

The configuration function is limited to reprogramming the following settings:

Time to Live (TTL):

- Check-in
- Status
- Alarm
- Trouble
- Restoral
- Tap
- Special

Timers:

- Check-in
- AC Report Delay
- Network Report Delay
- Comm Timeout


3.2 Profile Setup

This section describes how to setup, store, and manage the configuration profiles using the CLI interface. This interface is engaged by connecting the CDT to a PC via a USB port, and using a terminal emulator for communications. The main prompt will be “CDT-MAIN”. Type “sct” to enter the subscriber configuration menu (CDT-SCT). Entering “?” will list the available commands.

3.2.1 Profile Management

When managing profiles, the format is: <function> <src/dest> <value>


Example: wri pro 7788-default (write profile “7788-default”)

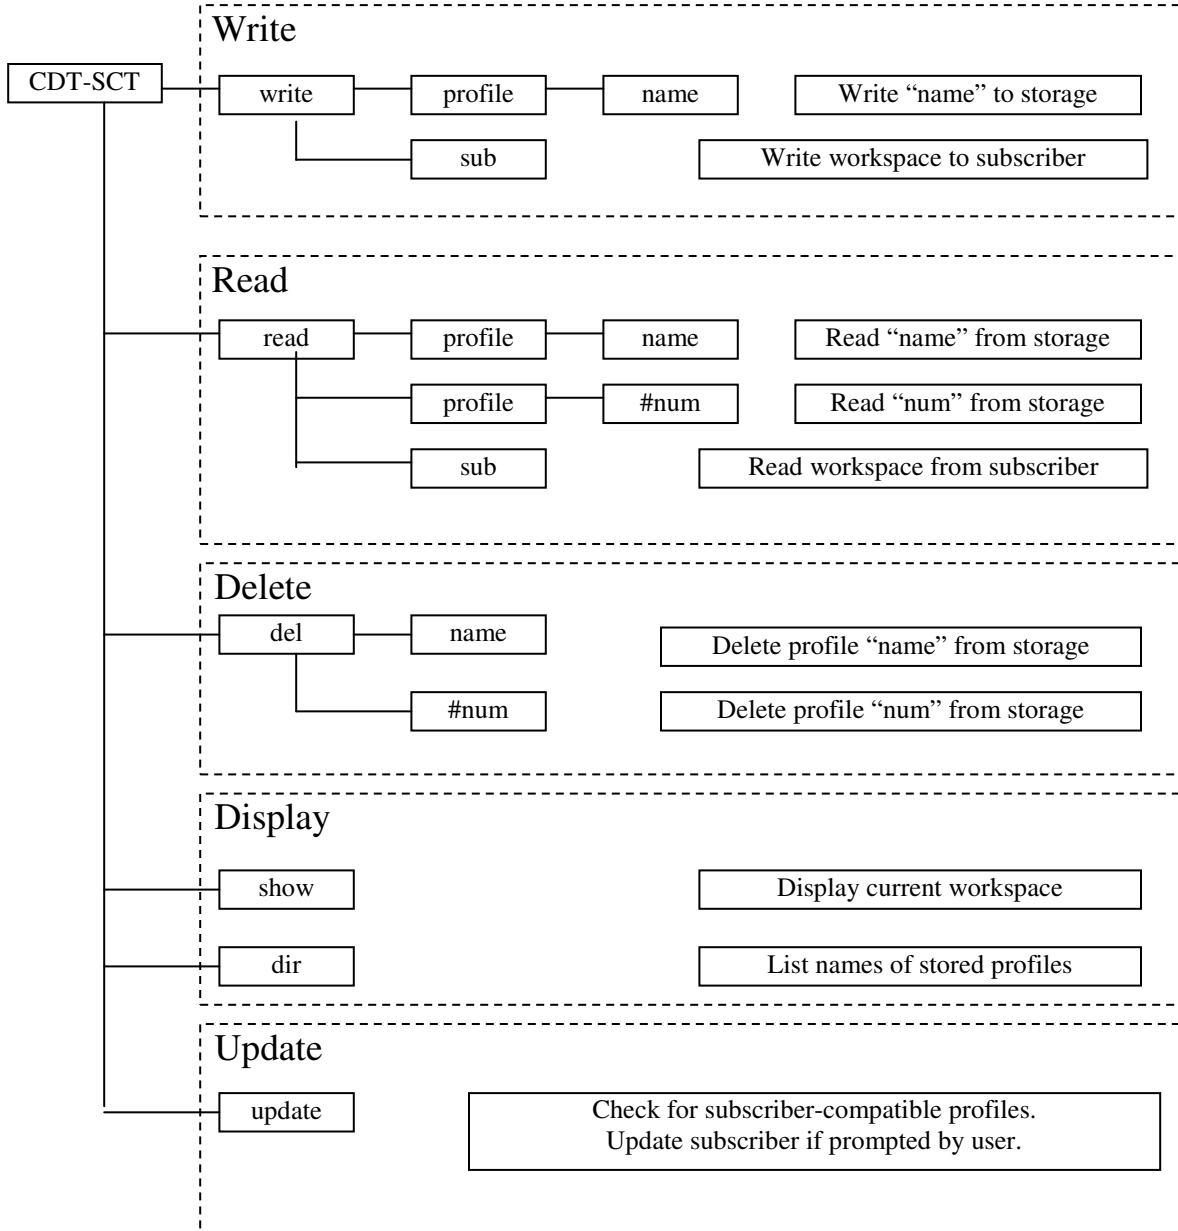

3.2.2 Profile Editing

When editing a profile, the CLI format is: <group> <name> <value>

Example: ttl cki 01:05 (set the check-in time to live to 1 hour, 5 minutes)

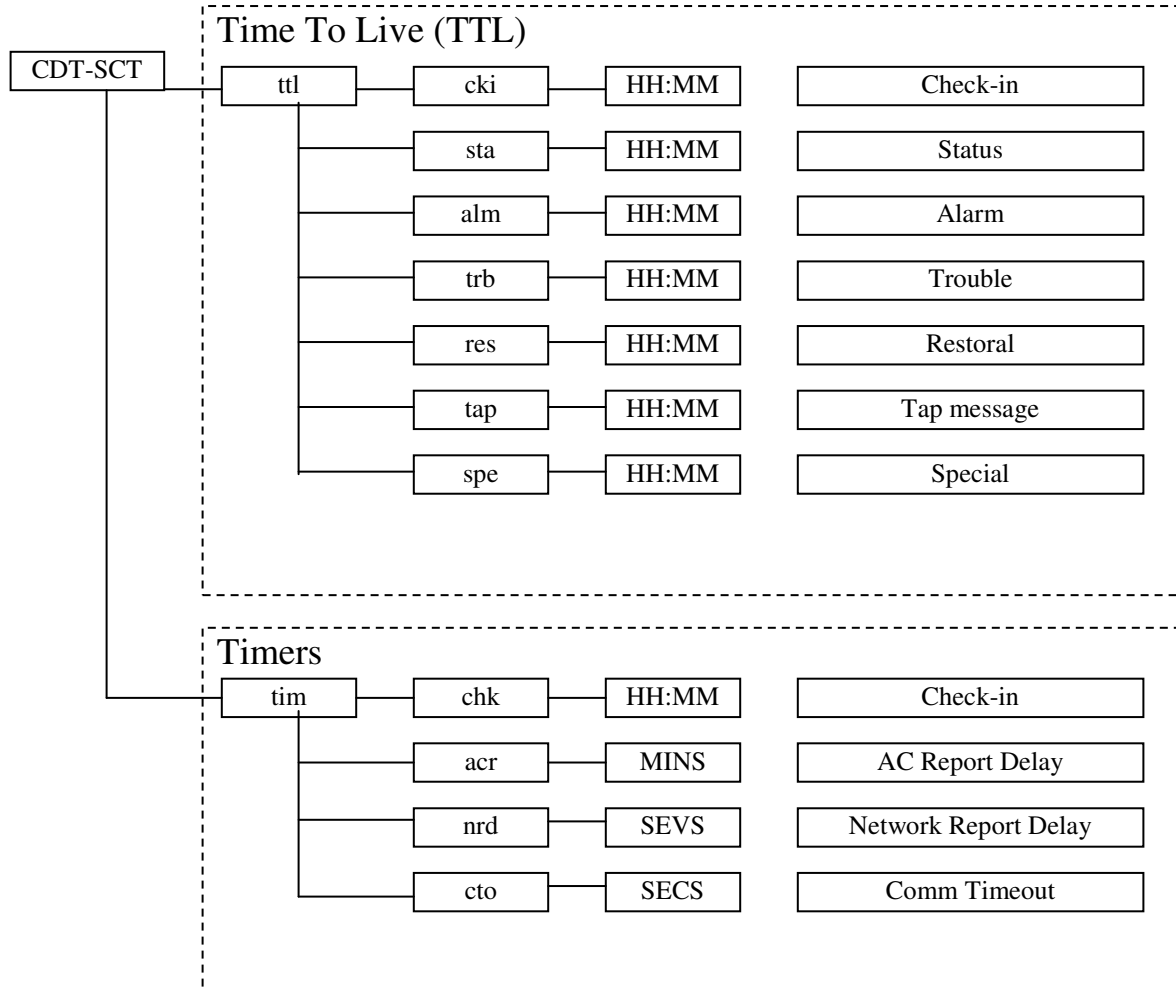

3.2.3 Default Profiles

The CDT has a set of default profiles pre-loaded from the factory. These profiles can be used to configure the following subscriber models:

Fire: 7744, 7788
 Burg: 7050, 7058, 7350, 7450, 7650

The default values are listed in the following table:

TTL Parameter	Burg (hh:mm)	Fire (hh:mm)
Check-in TTL	00:10	00:10
Status TTL	00:10	00:10
Alarm (Zones) TTL	03:00	03:00
Restoral (Zones)TTL	03:00	03:00
Trouble/Rest(Zones)TTL	03:00	03:00
TAP messages TTL	03:00	00:10
Special TTL	00:10	00:10
Timer Parameter	Burg	Fire
Check-in timer	23:45	23:45
AC Report Delay timer	Random	Random
Network Report Delay	10 sec	10 sec
Comm TimeOut timer	121 sec	61 sec

3.2.4 Special TTL Profile

The CDT can store special TTL values of 00:03 for limited use. To create a profile with this special value, the command line is "ttl <name> 00:x3", instead of ttl <name> 00:03.

This is an example of a special TTL profile:

TTL Parameter	(hh:mm)
Check-in TTL	00:03
Status TTL	00:03
Alarm (Zones) TTL	03:00
Restoral (Zones)TTL	00:03
Trouble/Rest(Zones)TTL	03:00
TAP messages TTL	03:00
Special TTL	00:03
Timer Parameter	
Check-in timer	23:45
AC Report Delay timer	Random
Network Report Delay	10 sec
Comm TimeOut timer	121 sec

3.2.5 CLI Script

The CLI commands can be entered into a text file script and send to the CDT via the terminal as a text file transfer. A row of 20 “#” characters is required after each command, except after the final “write pro” command. The script file may contain other comment lines beginning with the “#” character, which will be ignored by the CDT. This is an example script to create a profile named “7788F-cfg1” for programming a 7788F subscriber:

```
# Configuration for 7788F
#
# TIME TO LIVE
# TTL check-in 00:10
ttl cki 00:10
#####
# TTL status report 00:10
ttl sta 00:10
#####
# TTL alarm from zones 03:00
ttl alm 03:00
#####
# TTL trouble and its restorals from zones 03:00
ttl trb 03:00
#####
# TTL restoral from zones (alarm) 03:00
ttl res 03:00
#####
# TTL tap messages (Dialer) 00:10
ttl tap 00:10
#####
# TTL special 00:10
ttl spe 00:10
#####
#
# TIMERS
# TIMER Check-in 23:45
tim chk 23:45
#####
# TIMER AC report delay
#     use tim acr R for random
#     use time acr NN for NN minutes (max=60)
tim acr R
#####
# TIMER Network Report Delay (seconds) 10
tim nrd 10
#####
# save to profile named 7788F-cfg1
write pro 7788F-cfg1
y
```


4 Subscriber Configuration

A configuration can be read from a subscriber, and can optionally be saved as a profile. In addition, an existing profile can be written to a subscriber.

4.1 Read Subscriber Configuration

At the CDT-SCT prompt, type “read sub”. The subscriber configuration will be read and displayed:

```

PROFILE:7058-2.81
  TTL (ttl)
    CHECKIN      (cki) - 00:10
    STATUS       (sta) - 00:10
    ALARM        (alm) - 03:00
    TROUBLE      (trb) - 03:00
    RESTORAL     (res) - 03:00
    TAP          (tap) - 03:00
    SPECIAL      (spe) - 00:10
  TIMERS (tim)
    CHECKIN TIME (chk) - 00:01
    AC REPORT DLY (acr) - RANDOM
    NW REPORT DLY (nrd) - 010 sec
    COMM TIMEOUT (cto) - 180 sec

```

4.2 Save Subscriber Configuration

To save this configuration profile, type “write pro” to store a profile with the current name, or “write pro <name>” to store it under a different name. The response should be:

```
Saving "7058-2.81"
```

4.3 Configuring the Subscriber

To configure the subscriber, type “update” at the command line. The CDT will determine the subscriber model, and will search through the list of available profiles for a match to the mode type (ex: 7744). The user will be prompted to update to a profile, and has the option to update to that profile, or skip to the next one.

```

Sub: 7058-2.81
Profile found
  7058-default
  7058-2.81
Update with profile:
"7058-default" ?
(y/n)

```

If “y” is selected, the new values will be loaded to the subscriber:

```

Updating...
Setting TTLs...
Setting TIMERS...
Done

```

5 Diagnostics

The diagnostics interface is engaged by typing “diag” at the CDT-MAIN prompt. The user is presented with the CDT-DIAG prompt. This interface provides all the CDT Diagnostics functions via a text-based interface. Enter the name of the desired test at the prompt, or hit “?” to get a list of available options. Terminate any repeating tests by hitting the ESC key. The diagnostics options are:

```

status - get subscriber status
zones  - get zones status
routing - get routing info
packets - start packet monitor
history - show packet history
pstats - show packet history stats
store  - store packet history in flash
recall - recall packet history from flash
delete - delete packet history from flash

```

5.1 Status

Poll for subscriber status (CTRL_N) once per second and display the response:

```

MODEL VER  ID  PEER
7058  2.81  5710  2406
LL:1  NC:5  Stat:000      (LL=Link Layer, NC=Netcon)
Status: OK

```

5.2 Zones

Poll for zone status (CTRL_Z) once per second and display the response:

```

Zones normal:  ZONES      <ESC:Exit>
                Zx00, Z1-8:0000-0000
                Zones Normal

Zone 1 alarm:  ZONES      <ESC:Exit>
                Zx01, Z1-8:1000-00T0
                Z1:ALARM
                Z3:norm
                Z2:norm
                Z4:norm

Zone 7 trouble: ZONES      <ESC:Exit>
                Zx01, Z1-8:1000-00T0
                Z5:norm
                Z7:norm
                Z6:TRBL
                Z8:norm

```

5.3 Routing

Poll for routing table (CTRL_T) once per second and display the routing table and number of Ok peers (Q=2,3) vs Total peers:

```

Peers  Ok:3  Total:3
1.2406, L:00, N:0, Q:03
2.7350, L:01, N:5, Q:03
3.0101, L:01, N:5, Q:03

```

5.4 Packets

Initiates the packet monitoring session. Collects and displays packets received and transmitted by the subscriber, and accumulated count of Rx, Tx, and Ack packets:

```
SEQ SRC  DEST  TYPE
C1  7013>2406  D_CHK  - Rx:1   Tx:0   Ak:0
C1  2406>7013  P_ACK  - Rx:2   Tx:0   Ak:0
84  5710>2406  D_CHK  - Rx:2   Tx:1   Ak:0
84  2406>5710  P_ACK  - Rx:3   Tx:1   Ak:1
A5  0101>2406  D_CHK  - Rx:4   Tx:1   Ak:1
A5  2406>0101  P_ACK  - Rx:5   Tx:1   Ak:1
```

5.5 History

Displays the packets collected during the previous packet monitoring session, or recalled from non-volatile flash:

```
C1  7013>2406  D_CHK
C1  2406>7013  P_ACK
84  5710>2406  D_CHK
84  2406>5710  P_ACK
A5  0101>2406  D_CHK
A5  2406>0101  P_ACK
```

5.6 Pstats

Displays the statistics from the previous packet monitoring session:

```
STATS:
Rx:5
Tx:1
Ack:1
```

5.7 Store

Stores the latest 255 entries in the packet history buffer to non-volatile flash.

5.8 Recall

Read the packets stored in non-volatile flash into the history buffer and display them.

5.9 Delete

Delete the history buffer stored in non-volatile flash.

6 Firmware Update

The CDT firmware can be updated via the USB port using the CDTProgrammer application. If the firmware requires an upgrade, follow these steps:

1. Connect the USB cable to the CDT
2. Determine the COM port connected to the USB port
3. Put the CDTProgrammer executable and the new CDT.hex file in a known directory
4. Open a command window and go to the directory
5. Execute the flash programmer with the following command line: (easiest with a .bat file)

```
<executable> -i <virtual usb com port> -b 115200 <file>
```

Example to load CDT.hex using COM8:

```
CDTProgrammer -i COM8 -b 115200 CDT.hex
```

6. Observe the following sequence in the command window. When complete, the CDT should boot to the new image. Re-open the terminal on the COM port to verify.

```
CDTProgrammer -i COM8 -b 115200 CDT.hex
```

```
Setting up  
Reading Target Device ID...Found dsPIC33FJ256GP506A (ID: 0x07f5)
```

```
Reading HexFile  
Reading Target
```

```
Programming Device..... Done
```

```
Update to: CDT Ver x.xxx
```

7 Revision History

Rev	Date	Author	Description
01	01/10/2014	PM	Initial document
02	01/27/2014	PM	Additional information
03	02/04/2014	PM	Additional information
04	02/06/2014	PM	Add HHM (section 6.1.4)
			Add LED blink pattern detail
05	02/18/2014	PM	Add packet Store/Recall functions
06	02/19/2014	PM	Add detail on menu structure and packet monitor function
07			Update menu text based in user input
08	02/26/2014	PM	Update default config list and cto value
			Reorder main menu
			Add bootloader description
09	03/6/2014	PM	2.1 Add IntelliPro auto-detect interface
			6.1.1.2.5 Remove last line of ### from script file